

Iris Power TGA-S™

Periodic On-Line Partial Discharge Monitoring Using a
Portable Instrument for Large High Speed Turbine Generators



A USER'S PERSPECTIVE:

"a 25 year-old generator, rated 700 MW, failed...This failure was found to be the result of slot discharge, since stator bar insulation had been abraded in the slot area. The damaged bars were removed, refurbished and re-installed...The post outage partial discharge tests indicated that the stator was in good condition and that there was little concern for the windings in the other two phases."

"We have not found another test method that produces as much decision support data for generator stator maintenance planning based on actual in-service insulation condition...Analysts were able to recommend the needed corrective maintenance before the maintenance outages began."

IRIS POWER TGA-S

PERIODIC ON-LINE PARTIAL DISCHARGE MONITORING OF LARGE TURBINE GENERATORS

The test enables predictive maintenance on large turbine generator directly water- or hydrogen-cooled stator windings, resulting in the increased availability and extension of operating life. The technique was introduced 20 years ago and has since been used on over 1000 turbine generators to identify deteriorated stator windings.

The method is non-destructive and based on proven scientific and empirical principles. The method has an exceptional low risk of false indications even on the largest generators. Recommended by manufacturers and industry standards such as the IEEE std. 1434-2000.

The monitoring technique is based on the application of Iris Power Stator Slot Coupler (SSC) partial discharge (PD) sensors, resulting in a high frequency measurement range and a favorable signal-to-noise ratio. This enables the automatic separation and recording of both partial discharges and noise so that test results can be easily interpreted.

The most common method of monitoring very large turbine generators involves using the portable Iris Power TGA-S instrument with multiple sets of permanently installed SSCs. The instrument is controlled by means of a computer and includes Windows™-based control and data display software.

Alternatively, continuous monitoring systems are available from Qualitrol-Iris Power. They can be integrated with plant SCADA and facilitate remote monitoring.

IRIS POWER TGA-S INSTRUMENT

Iris Power and Ontario Hydro developed the Iris Power TGA-S test with funding from the Canadian Electricity Association. The method enables the detection of stator insulation problems and was specifically designed to monitor partial discharges under normal generator operating conditions, i.e. normal electrical, mechanical, thermal and environmental operating stresses. The readings are not affected by normal external interference (or noise) such as power system corona, output bus arcing or other sources. The Iris Power TGA-S is also able to identify if the PD is occurring in the slot or in the endwinding. The tests are typically performed semi-annually and take about 30 minutes per generator. A combined Iris Power TGA-SB™ instrument can test both SSCs and the capacitive couplers used on smaller turbine generators and motors.

IRIS POWER STATOR SLOT COUPLER (SSC)

SSCs are permanently installed in the stator windings during a scheduled outage or during generator manufacturing. The SSC is a broadband antenna customized to detect the true partial discharge pulse shapes and the direction of propagation. Consequently, the Iris Power TGA-S system can classify the sources of partial discharges and separate electrical noise, thereby avoiding the risks of false indications. SSC sensors are less prone to the false indications that capacitive (Bus) couplers may experience due to spurious sparking within a large generator. SSCs are installed under the stator wedges, or between the top and bottom bars at the line-ends of each stator winding parallel.

The SSCs are connected with micro-coaxial cables to an external termination box. Hydrogen-cooled turbine generators are fitted with gas-tight connectors, or a standard Iris Power hydrogen sealed penetration.



Iris Power Stator Slot Coupler Installation in a stator slot.

IRIS POWER TGA-S TEST PROCEDURE


With the generator operating under normal service conditions, the operator connects the Iris Power TGA-S instrument to the previously installed coupler termination box and to a portable computer running the Iris Power software. The magnitude, phase position and number of partial discharge pulses measured from each coupler are then recorded and can be viewed immediately, or stored for a subsequent analysis. The results presented to the user include:

- graphs depicting the nature and severity of particular insulation aging mechanisms
- trend curves highlighting the progression of these mechanisms over time
- statistical values which can be compared with historical databases of similar generators.


In most cases, the assessment of the condition of stator winding insulation, based on the on-line partial discharge measurement, can be performed independently by the user after a short training course. Qualitrol-Iris Power can also assist the user with result interpretation using its unique growing database of over 225,000 results collected over 20 years on generators of all makes and sizes.

DETECTION OF PARTIAL DISCHARGES

The key factor in determining the condition of stator winding insulation is the trend in partial discharge activity. Stable TGA results indicate slow deterioration, while a doubling or tripling of the partial discharge activity, over a year, indicates accelerated winding deterioration. Good stator winding insulation indicates that partial discharge activity is less than that of a severely deteriorated winding by a factor of ten or more, making it relatively easy for plant maintenance personnel to determine which machines require maintenance. In large turbine generators, problems such as loose wedges, slot discharge, overheated insulation and polluted windings, are detected by partial discharge testing. Additional problems, namely insufficient impregnation of the winding and grading coating deterioration can also be detected.

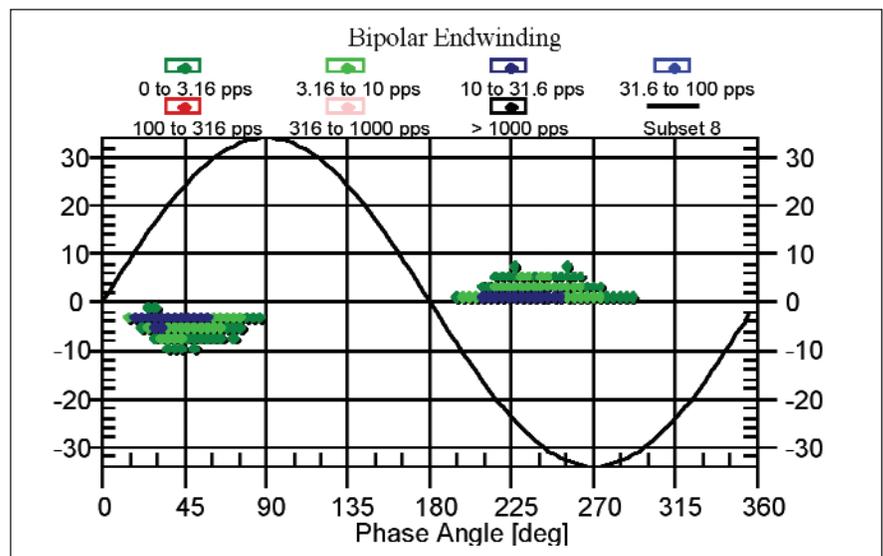

Endwinding PD

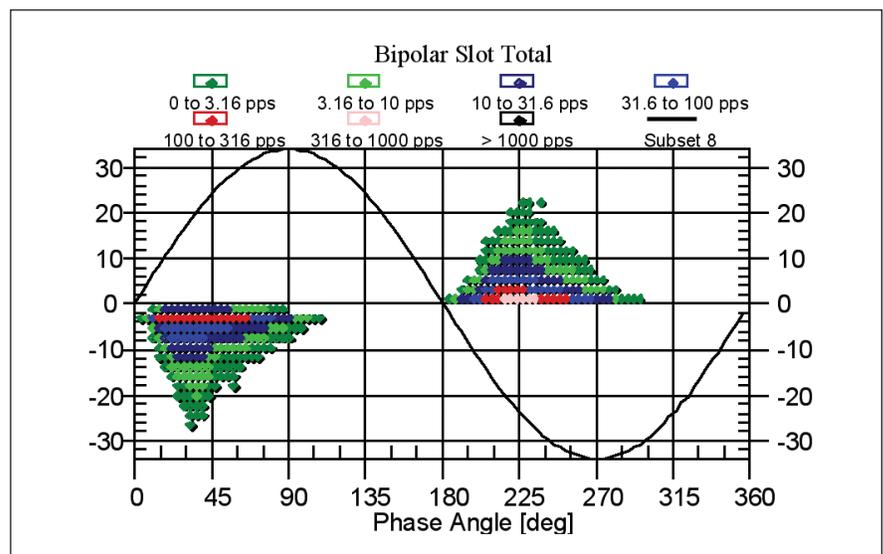

Slot PD

IRIS POWER TGA-S

PLANNING PREDICTIVE MAINTENANCE USING ON-LINE PARTIAL DISCHARGE MONITORING

Stator winding insulation problems in both air and hydrogen-cooled turbine generators are one of the principal causes of forced outages, which result in lost revenues. On-line partial discharge monitoring, a proven technique developed by Ontario Hydro and the Canadian Electrical Association, helps to minimize the risk of unexpected stator winding failure. Using permanently installed couplers and a portable instrument, utility plant personnel worldwide have found this method reliable and easy to use.

Since the inception of the on-line Iris Power TGA-S test 20 years ago, dozens of published case studies by users of this technology have confirmed the following benefits:

- the root causes of stator problems can be identified and often repaired at an earlier stage. Even more important, using SSCs, maintenance personnel will know beforehand if repairs are needed on the endwinding or within the stator slots
- the monitoring can increase the availability of generators, and can contribute to the extension of the useful life of the unit windings. This is especially likely with large water-cooled stators, since winding life >50 years is often achieved
- intervals between generator inspection outages can be increased if the Iris Power TGA-S results are good
- most stator winding in-service failures can be avoided
- can be applied to existing and new turbine generators.

WORLDWIDE INDUSTRY ACCEPTANCE OF ON-LINE PD MONITORING

The partial discharge test has won worldwide acceptance with all major utilities. This general acceptance has been achieved because:

- partial discharges are a symptom of most of the stator winding insulation failure processes
- the test has been proven effective in numerous installations by identifying generators which require stator winding maintenance
- the test equipment is cost-effective
- the test is performed on-line and requires no generator shut-down
- generator station staff can perform the test and interpret the results with minimal training.

Iris Power TGA-S and Iris Power TGA-SB are trademarks of Qualitrol-Iris Power.

Windows is a registered trademark of Microsoft Corporation in the United States and other countries.

QUALITROL-IRIS POWER HAS BEEN THE WORLD LEADER IN MOTOR AND GENERATOR WINDING DIAGNOSTICS SINCE 1990, PROVIDING A FULL LINE OF ON-LINE AND OFF-LINE TOOLS, AS WELL AS COMMISSIONING AND CONSULTING SERVICES.



A **QUALITROL** Company

www.irispower.com

www.qualitrolcorp.com

Iris Power LP
3110 American Drive
Mississauga, ON, Canada L4V 1T2
Phone: 1-905-677-4824
Fax: 1-905-677-8498
sales.iris@qualitrolcorp.com

Qualitrol Company LLC
1385 Fairport Road
Fairport, NY, USA 14450
Phone (585) 586-1515
Fax (585) 377-0220



QUALITROL
Defining Reliability

Ver 8 • 08/10